NuTone

DESCRIPTION

- Energy-saving Fluorescent Fan-Light Combination utilizes one (1) NEMA Type CFQ13W/G24q 13 watt compact fluorescent lamp (lamp must be purchased separately).
- Electronic Ballast
- White polymeric grille with break resistant polymeric lens.
- Quiet operation with molded polymeric duct collar and backdraft damper.
- 9" x 9" x 5³/₄" galvanized steel housing.
- Plug-in motor and light.
- Uses 4" duct.
- For baths up to 65 sq. ft., other rooms up to 85 sq. ft.
- Refer to NuTone's catalog for a complete listing of accessories to effectively adapt this Fan-Light Combination to your construction requirements.


DESIGN FEATURES

| Air Delivery: | 70 CFM at 0.10" S.P. | |
|---------------------------|---|--|
| Sound Level: | 3.0 Sones. | |
| Dimensions: | Housing: 9" x 9" x 5¾". | |
| | Grille: 10 ³ / ₄ " x 12 ¹ / ₄ ". | |
| Material & Finish: | ousing: Galvanized steel. | |
| | Grille: White polymeric. | |
| Motor: | Shaded pole, thermally protected, | |
| | 115vAC, 60 Hz, 1.1 amp. | |
| Blower Wheel: | One-piece polypropylene, | |
| | 4¾" diameter. | |
| Duct Size: | 4" diameter. | |
| Electrical Rating: | 120 V, 60 Hz, 1.3 A. | |
| Mounting: | Mounting flanges provided. | |
| Ballast: | Electronic. | |
| | | |

ARCHITECT'S SPECIFICATIONS

Fluorescent Fan-Light Combination shall be NuTone Model Number 769RFT as manufactured by NuTone according to listed specifications. Fan shall ventilate 70 CFM at 0.10 S.P. at a sound level of 3.0 Sones. Housing shall be 9" x 9" x $5^{3}/_{4}$ " and connect to 4" duct.

Economy Fluorescent Fan-Light MODEL: 769RFT

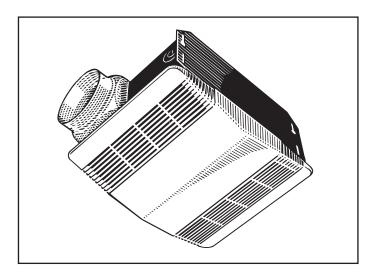

INSTALLATION

• Not for use in kitchens.

- Complete installation instructions are included with each unit.
- Suitable for use over tub or shower when installed in a GFI protected branch circuit.
- Type IC for use with thermal insulation
- Not for use with solid state speed controls.





NuTone, Inc., 4820 Red Bank Road, Cincinnati, OH 45227 Product specifications subject to change without notice.

| REFERENCE | QTY. | REMARKS | Project |
|-----------|------|---------|-------------------|
| | | | Location |
| | | | Architect |
| | | | Engineer |
| | | | Contractor |
| | | | Submitted by Date |

CERTIFIED TEST DATA




HVI-2100 CERTIFIED RATINGS comply with new testing technologies and procedures prescribed by the Home Ventilating Institute, for off-the-shelf products, as they are available to consumers. Product performance is rated at 0.1 in. static pressure, based on tests conducted in AMCA's state-of-the-art test laboratory. Sones are a measure of humanly-perceived loudness, based on laboratory measurements. This NuTone model is listed by Underwriters' Laboratories Inc.


The air delivery of a ventilating system may be determined by:

- Determine the equivalent duct length for each 90 degree elbow by adding one foot of duct length for each inch of duct diameter, i.e., a 4 inch diameter duct elbow equals 4 feet equivalent duct length and an 8 inch diameter duct elbow equals 8 feet equivalent duct length.
- 2. Add the total straight length of duct and the equivalent length for each elbow to obtain the total equivalent duct length.
- 3. Locate the intersection of the fan performance curve and the total equivalent duct length curves and draw a vertical line down to the CFM scale and read the system air performance.

(NOTE: 3¹/₄" x 10" duct equals 6 inch diameter duct.)

California Title 24 compatible electronic ballast

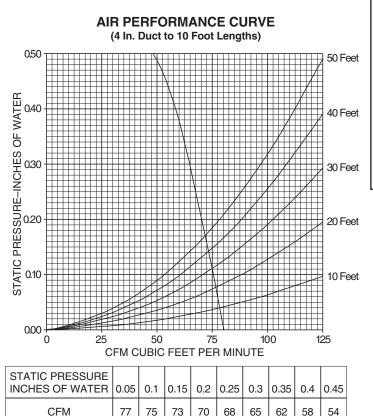

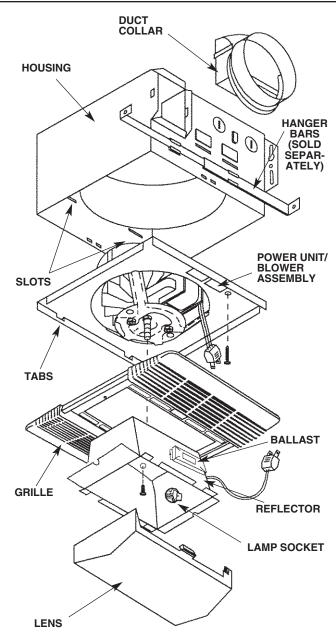



Product specifications subject to change without notice.