

FEATURES & BENEFITS

TEMPERED WATER

Heated, insulated blanket provides ANSI compliant tempered water in operating temperatures to -20° F (-30° C). Unit will stay tempered in non-extreme outdoor conditions (below 100° F (38° C)). Mounted over the Haws model 7501.

HAZARDOUS LOCATION

Complies with requirements for hazardous locations Class I, Division 2, Groups B, C, D, Temperature code T4; Class II, Division 2, Groups F, G.



OPTIONS


For more information, visit www.hawesco.com or call (888) 640-4297.

SPECIFICATIONS

Model 7501BL240H NEMA 4 heated, insulated blanket to provide ANSI compliant tempered water in operating temperatures to -20° F (-30° C). The self-contained blanket easily installs on to existing model 7501 units. Power cord not provided – power connection must be made according to code using Class I Division 2 compliant equipment. Rated 240VAC, 50/60 Hz, 0.64A. CSA certified for NEMA/Type 4 in Class 1, Division 2, Group B, C, D, T6, and Class 2, Division 2, Group F, G locations; and to ANSI/ISEA Z358.1

APPLICATIONS



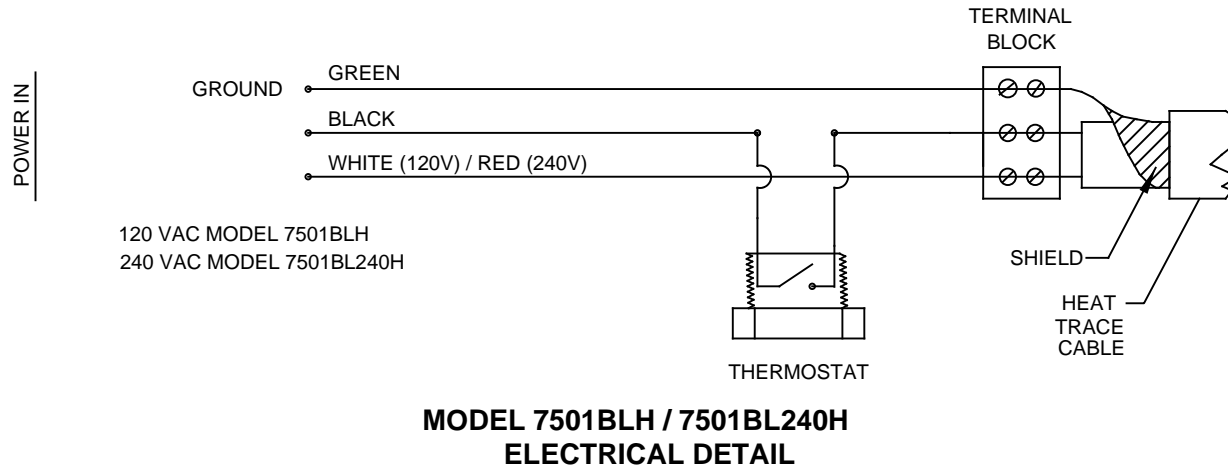

FOR MODELS 7501BLH & 7501BL240H:

1. ALL MODELS MUST HAVE A GROUND FAULT PROTECTION DEVICE (30mA GFCI) FOR HEAT TRACE. ELECTRICAL CURRENTS MAY BE INSUFFICIENT TO TRIP A CONVENTIONAL CIRCUIT BREAKER. ALL INSTALLATIONS MUST BE INSTALLED IN COMPLIANCE WITH LOCAL, STATE, AND/OR FEDERAL CODES.
2. ALL POWER CONNECTIONS MUST BE MADE ACCORDING TO NEC/CEC CODE USING FLEXIBLE CONDUIT OR CABLE RATED FOR NEMA/TYP 4 – NO RIGID CONNECTION PERMITTED. MODEL 7501BLH/ 7501BL240H REQUIRES MINIMUM NEMA/TYP 4 COMPLIANT EQUIPMENT. THE CORD AND FITTINGS SELECTED MUST HAVE THE APPROPRIATE HAZARDOUS LOCATION RATING REQUIRED FOR THE INSTALLATION LOCATION.

		1455 KLEPPE LANE SPARKS, NEVADA 89431 (775) 359-4712 FAX (775) 359-7424 E-MAIL: HAWS@HAWS.CO.COM WEBSITE: WWW.HAWS.CO.COM	
		ECN NO. 5235 REVISED PER: CC DRAWN: CC DATE: 12/28/17 CHK'D: MJ APPROVED: MJ DATE: 05/29/18	MODEL(S) 7501BLH / 7501BL240H ELECTRICAL SCHEMATIC
SCALE: 1:1 DRAWING TYPE: INSTALLATION SIZE: A SHEET 1 OF 1			