



THIS DOCUMENT IS TRUE AND CORRECT AT TIME OF PUBLICATION. CONTINUED PRODUCT IMPROVEMENTS MAKE SPECIFICATIONS AND MEASUREMENTS SUBJECT TO CHANGE WITHOUT NOTICE.

NOTES:

1. ALLOW 4 INCHES [102mm] PER SIDE FOR VENTILATION.
2. IT IS RECOMMENDED THAT ALL WATER OUTLETS BE NOT MORE THAN 7 FEET FROM THE CHILLER AND ALL COLD WATER PIPING BE COVERED WITH SPONGE RUBBER OR ICE WATER TYPE INSULATION OF ADEQUATE THICKNESS.
3. MAKE SURE POWER SUPPLY IS IDENTICAL IN VOLTAGE, CYCLE, AND PHASE TO THAT SPECIFIED ON THE COOLER SERIAL PLATE. NEVER WIRE COMPRESSOR DIRECTLY TO THE POWER SUPPLY.
4. MODEL NUMBERS AS LISTED ON UNITS:
 HCR8: HCR8*1J (115V, 60HZ)
 HCR8.50: HCR8*2J (220V, 50HZ)

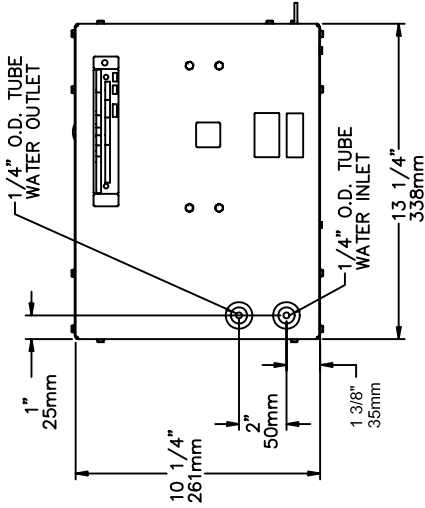


TOP VIEW

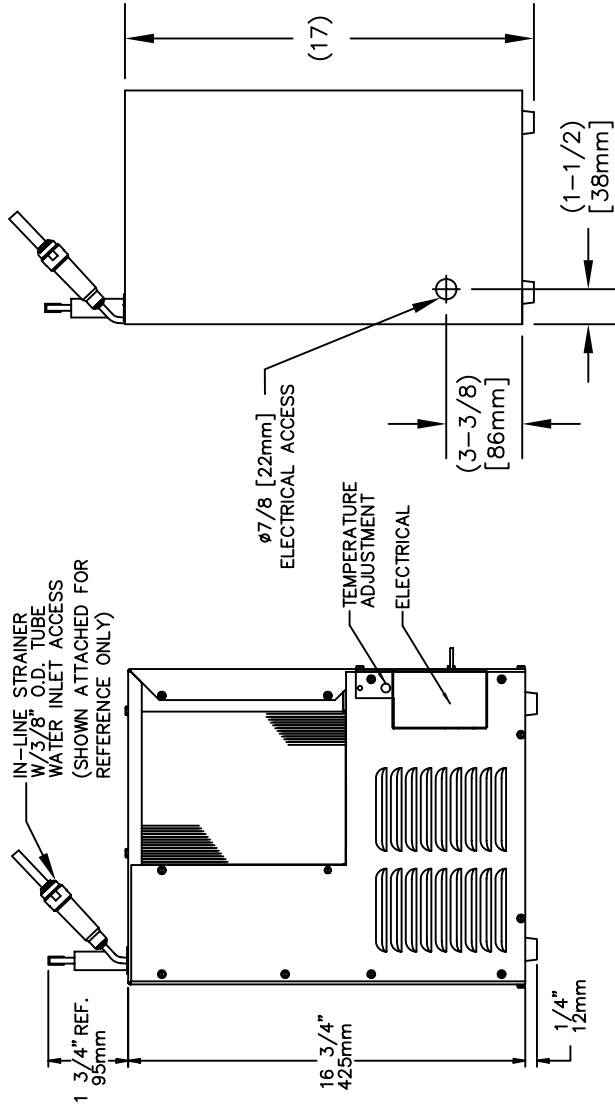

FRONT VIEW

SIDE VIEW



INFO FAX : 1-888-FAX-HAWS (1-888-329-4297)
 1455 Kleppe Ln, Sparks NV, 89431
 Phone: 775-359-4712 Fax: 775-359-7424
 Haws Ag Bachweg 3 CH-3401 Burgdorf Switzerland
 Haws Mfg Pte Ltd 74 Sungai Kadut Loop Singapore 729631
 e-mail: Haws@hawsco.com website: www.hawsco.com

ECR NO:	REVISED BY:	ISS:	MODEL(S):
AD	ECN: 4194	LVVC	HCR8/HCR8.50
DATE:	DATE:	CHD:	INFO FAX DOC #:
5/22/08			24278/2427850
APPROVED:	DATE:	SCALE:	DRAWING TYPE:
		N/A	INSTALLATION/FABRICK
			SIZE: A
			SHT: 1 OF 1
			REV: 2
			DATE: 0002075001.D
			15352A00