Job Name/Location: Tag No:

For: File Resubmit Date: Approval Other PO No.:

**Architect:** GC: Mech:

Engr:

Rep: (Project Manager)

### LMU183HV

### Multi F Inverter Heat Pump Outdoor Unit

### Performance:

Cooling Capacity (MinRated-Max., Btu/h)	8,400~18,000~21,600
Heating Capacity (MinRated-Max., Btu/h)	10,080~22,000~25,000
Max. Heating Capacity at 5°F (Btu/h)	17,700
Max. Heating Capacity at 0°F (Btu/h)	16,090
Max. Heating Capacity at -4°F (Btu/h)	14,800
EER2	13.5
SEER2	22.5
COP	3.6
HSPF2	9.6

Cooling Nominal Test Conditions: Heating Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Indoor: 70°F DB / 60°F WB Outdoor: 95°F DB / 75°F WB Outdoor: 47°F DB / 43°F WB

### **Electrical:**

Power Supply (V/Hz/Ø) <sup>1</sup>	208-230V, 60, 1
MOP (A)	20
MCA (A)	15.8
Recommended Fuse Size (A)	20
Cooling Rated Amps (A)	12.8
Heating Rated Amps (A)	12.8
Compressor (A)	12.0
Fan Motor (A)	0.40
Locked Rotor Amps (A)	16.0

MOP - Maximum Overcurrent Protection MCA - Minimum Circuit Ampacity

### Piping:

Refrigerant Charge (lbs.)	3.97
Liquid Line Connection (in., O.D.)	1/4 x 2
Vapor Line Connection (in., O.D.)	3/8 x 2
Maximum Total Piping <sup>2</sup> (ft.)	164.0
Min. / Max. ODU to IDU Piping (ft.)	9.8 / 82.0
Piping Length (no add'l refrigerant, ft.)	98.4
Maximum Elevation between ODU and IDU (ft.)	49.2
Maximum Elevation between IDU and IDU (ft.)	24.6

ODU = Outdoor Unit IDU = Indoor Unit

#### Features:

- Auto operation
- Auto restart
- Inverter (variable speed compressor)
- Defrost / Deicing
- Restart delay (three [3] minutes)
- Self diagnosis
- Soft start
- Low ambient cooling down to 14°F









### **Operating Range:**

Cooling (°F DB)	14 to 118
Heating (°F WB)	-4 to +64

#### **Unit Data:**

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (Cool / Heat) ±1 dB(A) <sup>3</sup>	49 / 54
Net / Shipping Weight (lbs.)	101.0 / 109.8
Heat Exchanger Coating	Gold Fin™
Minimum No. of Indoor Units	2
Maximum No. of Indoor Units	2

### Compressor:

Туре		Twin Rotary
Quai	ntity	1
Oil /	Туре	FVC68D

#### Fan:

Туре	Propeller
Quantity	1
Motor / Drive	Brushless Digitally Controlled/Direct
Max. Airflow Rate (CFM)	1.766

### Notes:

- 1. Acceptable operating voltage: 187V 253V.
- 2. Piping lengths are equivalent.
- 3. Sound pressure levels are tested in an anechoic chamber under ISO Standard
- 4. All power / communication cable to be minimum 14 AWG, 4-conductor, stranded, shielded or unshielded wire, and must comply with applicable local and national codes. If shielded, the wire must be grounded to the chassis at the outdoor unit only.
- 5. Power wiring size must comply with the applicable local and national codes.
- 6. This data is rated 0 ft. above sea level, with 0 ft. level difference between outdoor and indoor units, and the following refrigerant pipe lengths: LMU183HV: 16.4 ft. x 2 = 32.8 ft.

LMU243HV: 16.4 ft. x 3 = 49.2 ft.

LMU303HV: 16.4 ft. x 4 = 65.6 ft.

LMU363HV: 16.4 ft. x 4 = 65.6 ft.

- All capacities are net with a combination ratio between 95 105%. 7. Must follow installation instructions in the applicable LG installation manual.
- 8. Refer to the Combintion Data Manual for combination capacity tables.
- 9. See the Performance Data Manual for sensible and latent capacities.

### **Optional Accessories:**

☐ PI-485 - PMNFP14A1 ☐ MultiSITE Comm. Mgr. -PBACNBTROA

☐ AC Smart 5 - PACS5A000

☐ ACP 5 - PACP5A000 ☐ Power Distribution Indicator (PDI)


Premium - PQNUD1S41


☐ Mobile LGMV - PLGMVW100 ☐ Drain Pan Heater - PQSH1203 □Low Ambient Baffle Kit (Cooling operation to -4°F) - ZLABGP03A

Page 1 of 2

# LMU183HV

### Multi F Inverter Heat Pump Outdoor Unit



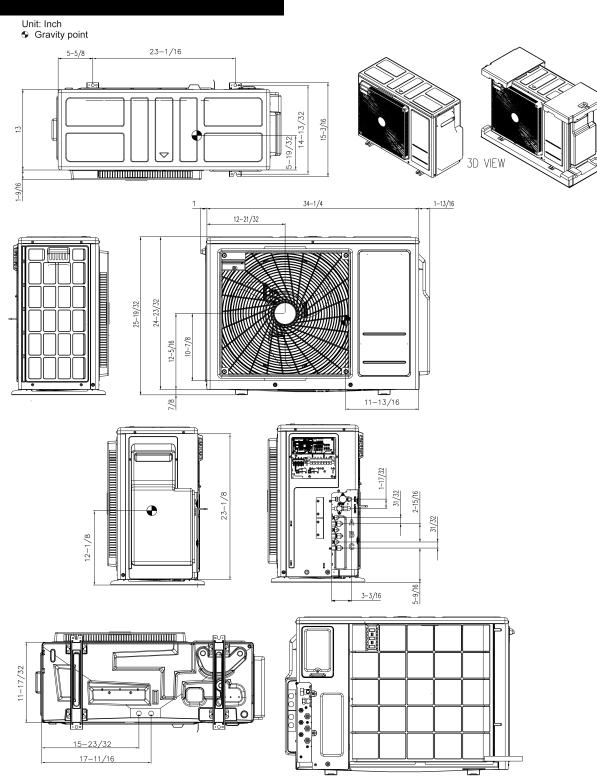

Notes:

- 1. Unit must be installed in compliance with the installation manual.
- 2. Unit must be grounded in accordance with the local or state regulations and applicable national codes.
- 3. All field-supplied electrical components and materials must comply with the local, state, and national codes.
- 4. Electrical characteristics must be considered for electrical work and design. The capacity of power cable and circuit breaker for the outdoor unit must follow local, state, national, and manufacturer requirements.

(BACK)

- 5. For LMU183HV Unit, ports A and B are available.
- 6. For LMU243HV Unit, ports A, B, and C are available.

Job Name/Location:

Tag No.:

Date:			
РО	No.:		

For:

File

Approval

Resubmit Other\_

**Architect:** 

GC:

Engr:

Mech:

Rep:

(Project Manager)

## PT-QAGW0

2' x 2' Cassette Panel


For Multi V™/Single-Zone /Multi F 4-Way Ceiling-Cassette Indoor Units







### **Unit Data:**

Color	White
RAL Color Code	RAL 9003
RGB Color Code	236 - 236 - 231
Material	ABS XG571
Net Dimensions (W x H x D, in.)	24-13/32 x 1-3/8 x 24-13/32
Shipping Dimensions	
(W x H x D, in.)	27-/32 x 5 x 26-1/2
Net Weight (lbs.)	6.3
Shipping Weight (lbs.)	8.6
Display LED Color	Green
Filter	Washable

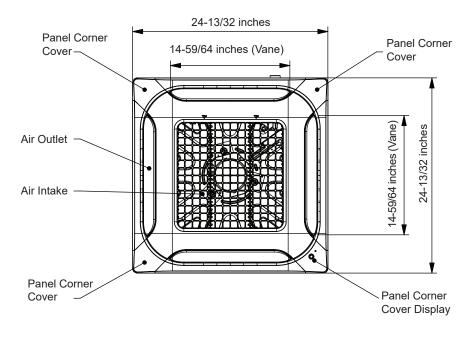





Date:		For:	File	Resubmit
PO No.:			Approval	Other
Architect:	GC:			
Engr:	Mecl	า:		
Ren:				

(Project Manager)



### LCN098HV4

Job Name/Location:

Multi F Ceiling Cassette Indoor Unit 9,000 Btu/h



### Performance:

(Company)

Nominal Cooling Capacity (Btu/h)	9,000
Nominal Heating Capacity (Btu/h)	10,400

Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

### Electrical:

Power Supply (V¹/Hz/Ø)	208-230/60/1
Rated Amps (A)	0.25

### Piping:

Installed Liquid Pipe (in., O.D.)	ø1/4
Installed Vapor Pipe (in., O.D.)	ø3/8
Liquid Connection (in., O.D.)	ø1/4
Vapor Connection (in., O.D.)	ø3/8
Drain (in., O.D. / I.D.)	1-1/4, 1
Temperature Sensor	Thermistor

### **Controls Features:**

- Two thermistor control
- 24-Hour on / off timer
- Auto operation
- Auto restart
- Chaos swing
- Control lock function
- Drain pump

- Group control
- Inverter (variable speed fan)
- · Compatible with accessory Wi-Fi
- Compatible with applicable Single Zone Outdoor Units (see single zone literature for matching system details)

### **Included Accessories:**

### • Wireless Remote Controller — AKB73757604

### **Required Accessories:**

- ☐ Grille Kit (27-9/16" x 27-9/16") PT-UQC, or
- ☐ Grille Kit (24-7/16" x 24-7/16") PT-QCHW0

### **Optional Accessories:**

- ☐ MultiSITE™ CRC1 Controller PREMTBVC0
- ☐ MultiSITE™ CRC1+ Controller PREMTBVC1
- ☐ Simple Remote Controller PREMTC00U
- ☐ Premium Remote Controller PREMTA000
- ☐ AC Smart Premium PQCSW421E0A
- ☐ ACP Premium PQCPC22A1
- ☐ ACP Standard PQCPC22N1
- ☐ LonWorks® Gateway\* PQNFB16A1
- ☐ BACnet® Gateway\* PQNFB17C1
- ☐ Remote Temperature Button Sensor ZRTBS01
- ☐ Simple Dry Contact (1 contact, 24 VAC external power) PDRYCB100
- ☐ Dry Contact for Third Party Thermostat PDRYCB300
- ☐ Dry Contact for Economizer PDRYCB400
- ☐ Plasma Filter Kit PTPKQ0
- ☐ Auxiliary Heater Kit PRARH1
- ☐ Wi-Fi Module PWFMDD200

### **Entering Mixed Air:**

Tag #:

Coo	ling (°F DB)	57 ~ 77
Hea	ting (°F WB)	59 ~ 81

### **Unit Data:**

R410A
EEV
36 / 33 / 30
Washable Pre-filter
29
34
7
9

#### Fan:

Type	Turbo
Quantity	1
	Brushless Digitally Controlled/Direct
Air Flow H/M/L (CFM)	300 / 265 / 230
	Type Quantity Motor/Drive Air Flow H/M/L (CFM)

#### Notes:

- NOLES:

  1. Acceptable operating voltage: 187V-253V.

  2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.

  3. Removable Washable Filter size: 14" x 14" x 1".

  4. See Engineering Manual for sensible and latent capacities.

  5. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.

  6. Power wiring cable size must comply with the applicable local and national code.

  7. The indoor unit comes with a dry helium charge.
- 7. The indoor unit comes with a dry feelind ratege.

  8. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 105%.

  9. Must follow installation instructions in the applicable LG installation manual.







<sup>\*</sup>BACnet® is a registered trademark of ASHRAE. LonWorks® is a registered trademark of Echelon Corporation.

JOD Name/Location.	Job	Name	/Location:
--------------------	-----	------	------------


# LCN098HV4

Multi F Ceiling Cassette Indoor Unit 9.000 Btu/h

Grille



Tag No.:	
Date:	

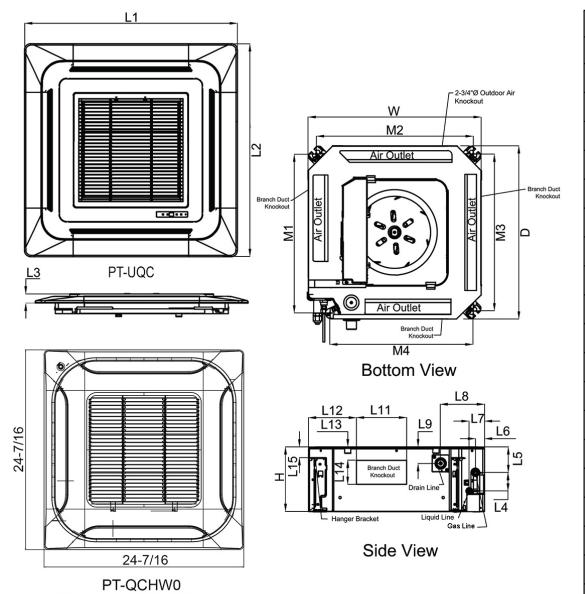

W	22-7/16"
Н	8-7/16"
D	22-7/16"
L1	27-9/16"
L2	27-9/16"
L3	7/8″
L4	2-13/32"
L5	3-7/8"
L6	1-3/16"
L7	1-15/16"
L8	5-5/8"
L9	1-1/32"
L10	1-11/32"
L11	6-1/2"
L12	5-13/16"
L13	3-3/16"
L14	3-1/8"
L15	1-11/32"
M1	20-19/32"
M2	20-3/8"
МЗ	20-3/8"
M4	18-5/32"