Job Name/Location: Tag No:

For: File Resubmit Date: Approval Other PO No.:

**Architect:** GC: Mech:

Rep:

Engr:

(Project Manager)

## LMU243HV

### Multi F Inverter Heat Pump Outdoor Unit

#### Performance:

Cooling Capacity (MinRated-Max., Btu/h)	8,400~24,000~25,000
Heating Capacity (MinRated-Max., Btu/h)	10,080~24,600~29,000
Max. Heating Capacity at 5°F (Btu/h)	18,400
Max. Heating Capacity at 0°F (Btu/h)	16,730
Max. Heating Capacity at -4°F (Btu/h)	15,400
EER2	12.5
SEER2	22.5
COP	4.2
HSPF2	9.4

Cooling Nominal Test Conditions: Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB Outdoor: 47°F DB / 43°F WB

#### **Electrical:**

Power Supply (V/Hz/Ø) <sup>1</sup>	208-230V, 60, 1
MOP (A)	20
MCA (A)	16.0
Recommended Fuse Size (A)	20
Cooling Rated Amps (A)	13.0
Heating Rated Amps (A)	13.0
Compressor (A)	12.0
Fan Motor (A)	0.40
Locked Rotor Amps (A)	16.0

MOP - Maximum Overcurrent Protection

MCA - Minimum Circuit Ampacity

#### Piping:

Refrigerant Charge (lbs.)	3.97
Liquid Line Connection (in., O.D.)	1/4 x 3
Vapor Line Connection (in., O.D.)	3/8 x 3
Maximum Total Piping <sup>2</sup> (ft.)	230.0
Min. / Max. ODU to IDU Piping (ft.)	9.8 / 82.0
Piping Length (no add'l refrigerant, ft.)	98.4
Maximum Elevation between ODU and IDU (ft.)	49.2
Maximum Elevation between IDU and IDU (ft.)	24.6

ODU = Outdoor Unit IDU = Indoor Unit

#### Features:

- Auto operation
- Auto restart
- Inverter (variable speed compressor)
- Defrost / Deicing
- Restart delay (three [3] minutes)
- Low ambient cooling down to 14°F

- Self diagnosis
- Soft start



#### **Operating Range:**

Cooling (°F DB)	14 to 118
Heating (°F WB)	-4 to +64

#### **Unit Data:**

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (Cool / Heat) ±1 dB(A) <sup>3</sup>	50 / 54
Net / Shipping Weight (lbs.)	101.4 / 110.2
Heat Exchanger Coating	Gold Fin™
Minimum No. of Indoor Units	2
Maximum No. of Indoor Units	3

#### Compressor:

Туре		Twin Rotary
Quar	ntity	1
Oil /	Туре	FVC68D

#### Fan:

Туре	Propeller
Quantity	1
Motor / Drive	Brushless Digitally Controlled/Direct
Max. Airflow Rate (CFM)	1.766

#### Notes:

- 1. Acceptable operating voltage: 187V 253V.
- 2. Piping lengths are equivalent.
- 3. Sound pressure levels are tested in an anechoic chamber under ISO Standard
- 4. All power / communication cable to be minimum 14 AWG, 4-conductor, stranded, shielded or unshielded wire, and must comply with applicable local and national codes. If shielded, the wire must be grounded to the chassis at the outdoor unit only.
- 5. Power wiring size must comply with the applicable local and national codes.
- 6. This data is rated 0 ft. above sea level, with 0 ft. level difference between outdoor and indoor units, and the following refrigerant pipe lengths: LMU183HV: 16.4 ft. x 2 = 32.8 ft.

LMU243HV: 16.4 ft. x 3 = 49.2 ft.

LMU303HV: 16.4 ft. x 4 = 65.6 ft. LMU363HV: 16.4 ft. x 4 = 65.6 ft.

All capacities are net with a combination ratio between 95 - 105%.

- 7. Must follow installation instructions in the applicable LG installation manual.
- 8. Refer to the Combintion Data Manual for combination capacity tables.
- 9. See the Performance Data Manual for sensible and latent capacities.

#### **Optional Accessories:**

☐ PI-485 - PMNFP14A1 ☐ MultiSITE Comm. Mgr. -PBACNBTR0A

☐ AC Smart 5 - PACS5A000

☐ ACP 5 - PACP5A000 ☐ Power Distribution Indicator (PDI)

Premium - PQNUD1S41

☐ Mobile LGMV - PLGMVW100 ☐ Drain Pan Heater - PQSH1203 □Low Ambient Baffle Kit (Cooling operation to -4°F) - ZLABGP03A











# LMU243HV

## Multi F Inverter Heat Pump Outdoor Unit



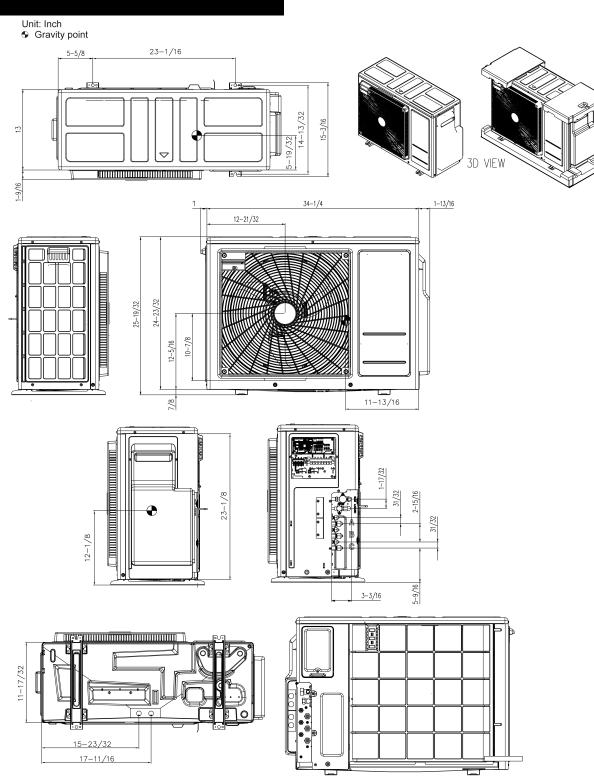

**Notes:**1. Unit must be installed in compliance with the installation manual.

- 2. Unit must be grounded in accordance with the local or state regulations and applicable national codes.
- 3. All field-supplied electrical components and materials must comply with the local, state, and national codes.
- 4. Electrical characteristics must be considered for electrical work and design. The capacity of power cable and circuit breaker for the outdoor unit must follow local, state, national, and manufacturer requirements.

(BACK)

- 5. For LMU183HV Unit, ports A and B are available.
- 6. For LMU243HV Unit, ports A, B, and C are available.

Job Name/Location: For: File Resubmit Date: PO No.: Approval Other GC: Architect: Mech: Engr: Rep: (Company) (Project Manager) LMAN097HVP Multi F Art Cool™ Gallery Life's Good 9,000 Btu/h Indoor Unit





### Performance:

Nominal Cooling Capacity (Btu/h) 9,000

Nominal Heating Capacity (Btu/h) 10,400

Cooling Nominal Test Conditions: Indoor: 80°F DB/67°F WB Outdoor: 95°F DB/75°F WB Heating Nominal Test Conditions: Indoor: 70°F DB/60°F WB Outdoor: 47°F DB/43°F WB

#### **Electrical:**

Power Supply (V¹/Hz/Ø)	208-230/60/1
Rated Amps (A)	0.2

#### Piping:

Liquid Line (in, OD)	1/4
Vapor Line (in, OD)	3/8
Drain OD, ID (in)	13/16, 5/8
Temperature Sensor	Thermistor

#### **Features:**

•24-Hour on/off timer
 •Auto operation
 •Auto restart
 •Condensate sensor
 •Chaos Swing
 •Jet Cool/Jet Heat
 •Self-cleaning indoor coil
 •Condensate sensor
 connection

•Inverter (variable speed fan) •Group control

#### **Included Accessories:**

•Wireless Handheld Remote Controller - AKB73635607

### **Optional Accessories:**

- LG Programmable Thermostat PREMTB10U
- Simple Controller with Mode (Black) PQRCVCL0Q
- Simple Controller with Mode (White) PQRCVCL0QW
- Simple Controller without Mode (Black) PQRCHCA0Q
- Simple Controller without Mode (White) PQRCHCA0QW
- AC Smart Premium PQCSW421E0A
- ACP Premium PQCPC22A1
- ACP Standard PQCPC22N1
- LonWorks Gateway PQNFB16A1
- BACnet Gateway PQNFB17B0
- AC Ez PQCSZ250S0
- Dry Contact Unit (1 contact, 24 VAC external power) PQDSB1
- Dry Contact Unit (2 input, power from indoor unit) PQDSBC
- Dry Contact for third party thermostat PQDSBNGCM1

#### **Operating Range:**

Tag #:

Cooling (°F WB)	57-77
Heating (°F DB)	59-81

#### **Unit Data:**

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure <sup>2</sup> H/M/L (±3 dB(A))	39/35/31
Primary Filter	Washable Pre-filter
Net Unit Weight (lbs)	32
Shipping Weight (lbs)	37

#### Fan:

Туре	Turbo
Quantity	1
Motor/Drive	Brushless Digitally Controlled/Direct
Airflow Rate H/M/L (CFI	M) 272/208/155

#### Notes:

- 1.Acceptable operating voltage: 187V 253V.
- 2.Sound Pressure levels are tested in an anechoic chamber under ISO Standard 1996.
- 3.See Engineering Manual for sensible and latent capacities.
- 4.All power/communication cable to be minimum 18 AWG, 4-conductor, stranded,
- shielded and must comply with applicable local and national code.
- 5. Power wiring cable size must comply with the applicable local and national code.
- 6.This unit comes with a dry helium charge.
- 7.Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95-105%

8. Must follow installation instructions in the applicable LG installation manual.







# LMAN097HVP Multi F Art Cool™ Gallery 9,000 Btu/h Indoor Unit



Tag #:
Date:

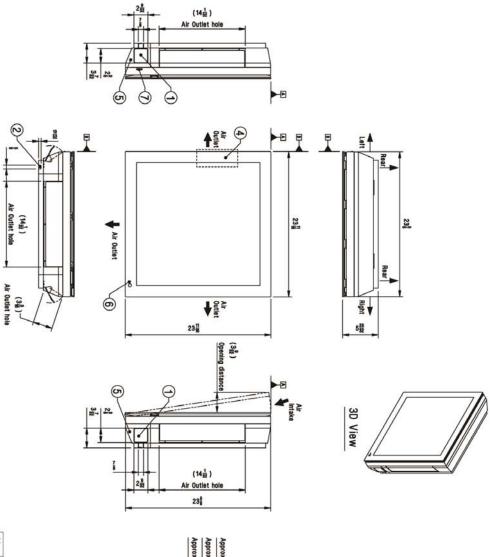

Kemo	D	5 Corne	4 Termi	3 Drain	2 Cable	1 Refrig	No.
Forced ON/OFF button	Remote controller signal reciever	Corner cover	Terminal block for power supply and communication	Drain hose connection	Cable routing hole	Refrigerant/drain pipe and cable routing hole	Part Name
	For wireless Type	10	Inside of front panel	•	7	Knock-out type	Description

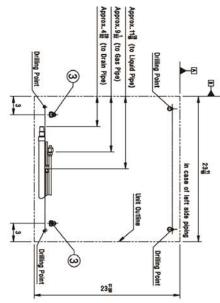

Job Name/Location: For: File Resubmit Date: PO No.: Approval Other GC: Architect: Mech: Engr: Rep: (Company) (Project Manager) LMAN127HVP Multi F Art Cool™ Gallery Life's Good





11,200 Btu/h Indoor Unit

### Performance:

Nominal Cooling Capacity (Btu/h)	11,200
Nominal Heating Capacity (Btu/h)	13,300

Cooling Nominal Test Conditions: Indoor: 80°F DB/67°F WB Outdoor: 95°F DB/75°F WB

Heating Nominal Test Conditions: Indoor: 70°F DB/60°F WB Outdoor: 47°F DB/43°F WB

#### **Electrical:**

Power Supply (V¹/Hz/Ø)	208-230/60/1
Rated Amps (A)	0.20

#### Piping:

Liquid Line (in, OD)	1/4
Vapor Line (in, OD)	3/8
Drain OD, ID (in)	13/16, 5/8
Temperature Sensor	Thermistor

#### **Features:**

•24-Hour on/off timer •Jet Cool/Jet Heat Auto operation •Self-cleaning indoor coil Auto restart Condensate sensor Chaos Swing connection

•Inverter (variable speed fan) •Group control

#### **Included Accessories:**

•Wireless Handheld Remote Controller - AKB73635607

### **Optional Accessories:**

- LG Programmable Thermostat PREMTB10U
- Simple Controller with Mode (Black) PQRCVCL0Q
- Simple Controller with Mode (White) PQRCVCL0QW
- Simple Controller without Mode (Black) PQRCHCA0Q
- Simple Controller without Mode (White) PQRCHCA0QW
- AC Smart Premium PQCSW421E0A
- ACP Premium PQCPC22A1
- ACP Standard PQCPC22N1
- LonWorks Gateway PQNFB16A1
- BACnet Gateway PQNFB17B0
- AC Ez PQCSZ250S0
- Dry Contact Unit (1 contact, 24 VAC external power) PQDSB1
- Dry Contact Unit (2 input, power from indoor unit) PQDSBC
- Dry Contact for third party thermostat PQDSBNGCM1

#### **Operating Range:**

Tag #:

Cooling (°F WB)	57-77
Heating (°F DB)	59-81

#### **Unit Data:**

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure <sup>2</sup> H/M/L (±3 dB(A))	42/38/34
Primary Filter	Washable Pre-filter
Net Unit Weight (lbs)	32
Shipping Weight (lbs)	37

#### Fan:

Туре	Turbo
Quantity	1
Motor/Drive	Brushless Digitally Controlled/Direct
Airflow Rate H/M/L (CFN	M) 314/258/198

#### Notes:

- 1.Acceptable operating voltage: 187V 253V.
- 2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 1996.
- 3.See Engineering Manual for sensible and latent capacities.
- 4.All power/communication cable to be minimum 18 AWG, 4-conductor, stranded,
- shielded and must comply with applicable local and national code.
- 5. Power wiring cable size must comply with the applicable local and national code.
- 6. This unit comes with a dry helium charge.
- 7. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 - 105%

8. Must follow installation instructions in the applicable LG installation manual.








# LMAN127HVP Multi F Art Cool™ Gallery 11,200 Btu/h Indoor Unit



Tag #: Date:

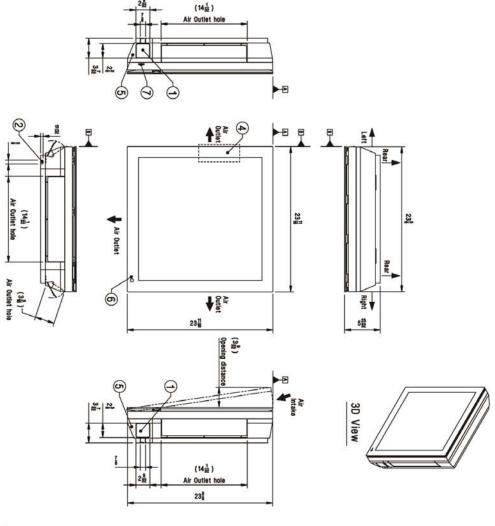

7 6	6 B	5 0	4 7	3	2 0	-	No.
Forced ON/OFF button	Remote controller signal reciever	Corner cover	Terminal block for power supply and communication	Drain hose connection	Cable routing hole	Refrigerant/drain pipe and cable routing hole	Part Name
	For wireless Type	T.	Inside of front panel	•	7	Knock-out type	Description

