Job Name/Location:

LMU363HV

Performance:

EER2

COP

SEER2

HSPF2

Electrical:

MOP (A)

MCA (A)

Piping:

Cooling Nominal Test Conditions:

Power Supply (V/Hz/Ø)¹

Cooling Rated Amps (A)

Heating Rated Amps (A) Compressor (A)

Locked Rotor Amps (A)

MOP - Maximum Overcurrent Protection

Refrigerant Charge (lbs.)

Liquid Line Connection (in., O.D.)

Vapor Line Connection (in., O.D.)

Min. / Max. ODU to IDU Piping (ft.)

Piping Length (no add'l refrigerant, ft.)

Maximum Elevation between ODU and IDU (ft.)

Maximum Elevation between IDU and IDU (ft.)

Maximum Total Piping² (ft.)

Fan Motor (A)

Recommended Fuse Size (A)

Indoor: 80°F DB / 67°F WB

Outdoor: 95°F DB / 75°F WB

Multi F Inverter Heat Pump Outdoor Unit

Cooling Capacity (Min.-Rated-Max., Btu/h) Heating Capacity (Min.-Rated-Max., Btu/h)

Max. Heating Capacity at 5°F (Btu/h)

Max. Heating Capacity at 0°F (Btu/h) Max. Heating Capacity at -4°F (Btu/h)

Engr: Rep:

(Company)

Tag	No:

Date:	F	or:	File	Resubmit	_
PO No.:			Approval	Other	
Architect:	GC:				

Heating Nominal Test Conditions:

MCA - Minimum Circuit Ampacity

Indoor: 70°F DB / 60°F WB

Outdoor: 47°F DB / 43°F WB

Mech:

(Project Manager)

8,400~32,800~38,400

10,080~36,000~41,600

25.200

22.750

20,800

12.5

21.5

3.9

9.0

25

25 15.03

18.4

15.03

13.5

0.73

19.0

6.17

1/4 x 4

3/8 x 4

9.8 / 82.0

246.1

98.4

49.2

24.6

208-230V, 60, 1







Operating Range:

Cooling (°F DB)	14 to 118
Heating (°F WB)	-4 to +64

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (Cool / Heat) ±1 dB(A) ³	51 / 54
Net / Shipping Weight (lbs.)	138.9 / 154.3
Heat Exchanger Coating	Gold Fin™
Minimum No. of Indoor Units	2
Maximum No. of Indoor Units	4

Compressor:

Туре	Twin Rotary
Quantity	1
Oil / Type	FVC68D

Fan

ran.	
Туре	Propeller
Quantity	1
Motor / Drive	Brushless Digitally Controlled/Direct
Max. Airflow Rate (CFM)	2.119

Notes:

1. Acceptable operating voltage: 187V - 253V.

2. Piping lengths are equivalent.

- 3. Sound pressure levels are tested in an anechoic chamber under ISO Standard 3745
- 4. All power / communication cable to be minimum 14 AWG, 4-conductor, stranded, shielded or unshielded wire, and must comply with applicable local and national codes. If shielded, the wire must be grounded to the chassis at the outdoor unit only.

5. Power wiring size must comply with the applicable local and national codes. 6. This data is rated 0 ft. above sea level, with 0 ft. level difference between outdoor

- and indoor units, and the following refrigerant pipe lengths:
- LMU183HV: 16.4 ft. x 2 = 32.8 ft.
- LMU243HV: 16.4 ft. x 3 = 49.2 ft. LMU303HV: 16.4 ft. x 4 = 65.6 ft.
- LMU363HV: 16.4 ft. x 4 = 65.6 ft.
- All capacities are net with a combination ratio between 95 105%.
- 7. Must follow installation instructions in the applicable LG installation manual.
- 8. Refer to the Combintion Data Manual for combination capacity tables.
- 9. See the Performance Data Manual for sensible and latent capacities.
- Low ambient cooling down to 14°F

□ Mobile LGMV - PLGMVW100 Drain Pan Heater - PQSH1200 Low Ambient Baffle Kit (Cooling operation to -4°F) - ZLABGP04A





For a complete list of available accessories, contact your LG representative

For continual product development, LG reserves the right to change specifications without notice.

© LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com

SB_MultiF_LMU363HV_2022_07_18_084716 Page 1 of 2

ODU = Outdoor Unit	

Features:


- Auto operation
- Auto restart
- Inverter (variable speed compressor) • Defrost / Deicing

Optional Accessories:

□ PI-485 - PMNFP14A1 □ MultiSITE Comm. Mgr. -**PBACNBTROA** AC Smart 5 - PACS5A000 \square ACP 5 - PACP5A000 □ Power Distribution Indicator (PDI) Premium - PONUD1S41

• Restart delay (three [3] minutes) • Self diagnosis • Soft start

IDU = Indoor Unit




energy	10


LMU363HV Multi F Inverter Heat Pump Outdoor Unit



 [Unit : mm(inch)] Gravity point

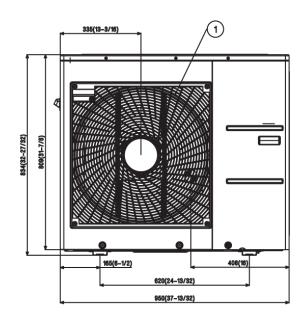

No.	Part Name
1	Air discharge grille
2	Vapor pipe connection
3	Liquid pipe connection
4	Main service valve (Liquid)
5	Main service valve (Vapor)

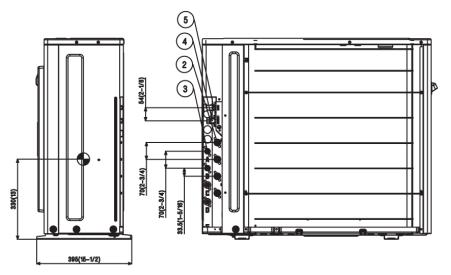

Notes:

- 1. Unit must be installed in compliance with the installation manual.
- 2. Unit must be grounded in accordance with the local or state regulations and applicable national codes.
- 3. All field-supplied electrical components and materials must comply with local, state, and national codes.
- 4. Electrical characteristics must be considered for electrical work and design. The capacity of power cable and circuit breaker for the outdoor unit must follow local, state, national, and manufacturer requirements.

Job Name/Location:					Tag #:		
Date:		For:	File	Resubmit			
PO No.:			Approval	Other			
Architect:	GC:				_	ąu	COLONGIA-
Engr:	Mech:				_		# 3

(Project Manager)

Rep: (Company)

LSN090HSV5

Multi F Wall Mounted High Efficiency Indoor Unit 9,000 Btu/h



Entering Mixed Air:

Cooling (°F WB)	57 ~ 77
Heating (°F DB)	59 ~ 81

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (H/M/L) (±3 dB[A]) ²	36 / 32 / 27
Primary Filter	Washable Pre-filter
Secondary Filter	3M Micro Dust
Net Weight (lbs.)	18.3
Shipping Weight (lbs.)	23.4

Fan:

Туре	Cross Flow
Type Quantity	1
Motor/Drive	Brushless Digitally Controlled/Direct
Air Flow H/M/L (CFM)	268 / 218 / 169

Notes:

INOTES: 1. Acceptable operating voltage: 187V-253V. 2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745. 3. See Engineering Manual for sensible and latent capacities. 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes. 5. Power wiring cable size must comply with the applicable local and national code. 6. The indoor unit comes with a dry helium charge. 7. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 - 105%. 8. Must follow installation instructions in the applicable LG installation manual.

Intertek

8. Must follow installation instructions in the applicable LG installation manual.





Performance:

Nominal Cooling Capacity (Btu/h)		9,000
Nominal Heating Capacity (Btu/h)		10,900
Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB	Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB	

Electrical:

Power Supply (V ¹ /Hz/Ø)	208-230/60/1
Rated Amps (A)	0.4

Piping:

Installed Liquid Pipe (in., O.D.)	ø1/4
Installed Vapor Pipe (in., O.D.)	ø3/8
Liquid Connection (in., O.D.)	ø1/4
Vapor Connection (in., O.D.)	ø3/8
Drain (in., O.D. / I.D.)	27/32 , 5/8
Temperature Sensor	Thermistor

Controls Features:

- 4-Way auto swing
 24-Hour on/off timer
 Auto operation
- Auto restart
 Chaos wind
- Self-cleaning indoor coil
 Sleep mode
 Condensate sensor connection
 Built-in Wi-Fi via Smart ThinQ app

Jet cool/Jet heat
3M Micro Dust Filter

 Inverter (variable speed fan) Compatible with Single Zone HSV5 Outdoor Units


Included Accessories:

Wireless Remote Controller — AKB74955602

Optional Accessories:

- □ MultiSITE™ CRC1 PREMTBVC0 □ MultiSITE CRC1+ PREMTBVC1 □ Dry Contact PDRYCB300

SB_MultiF_WallMount_HiEff_IDU_LSN090HSV5_2022_11_09_122831 Consider the second sec

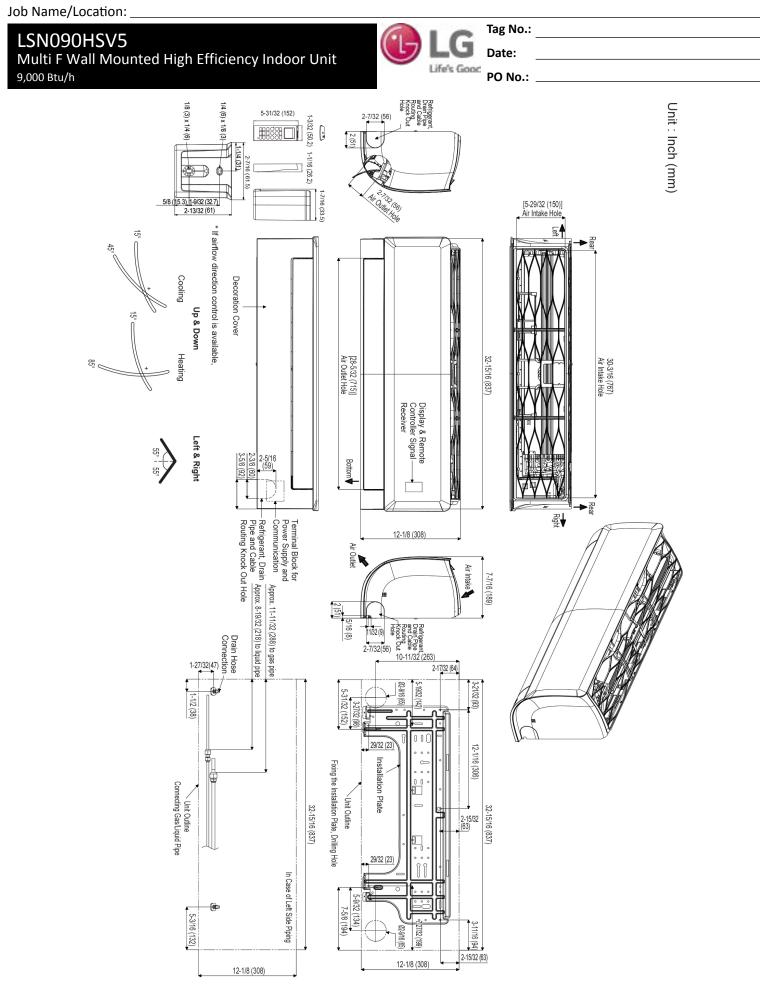

For continual product development, LG reserves the right to change specifications without notice. SB_MultiF_\ © LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com SB_MultiF_WallMount_HiEff_IDU_LSN090HSV5_2022_11_09_122831

Page 2 of 2

Job Name/Location:					Tag #:		
Date:		For:	File	Resubmit			
PO No.:			Approval	Other			
Architect:	GC:				_	ąu	COLONGIA-
Engr:	Mech:				_		# 3

(Project Manager)

Rep: (Company)

LSN090HSV5

Multi F Wall Mounted High Efficiency Indoor Unit 9,000 Btu/h



Entering Mixed Air:

Cooling (°F WB)	57 ~ 77
Heating (°F DB)	59 ~ 81

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (H/M/L) (±3 dB[A]) ²	36 / 32 / 27
Primary Filter	Washable Pre-filter
Secondary Filter	3M Micro Dust
Net Weight (lbs.)	18.3
Shipping Weight (lbs.)	23.4

Fan:

Туре	Cross Flow
Type Quantity	1
Motor/Drive	Brushless Digitally Controlled/Direct
Air Flow H/M/L (CFM)	268 / 218 / 169

Notes:

INOTES: 1. Acceptable operating voltage: 187V-253V. 2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745. 3. See Engineering Manual for sensible and latent capacities. 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes. 5. Power wiring cable size must comply with the applicable local and national code. 6. The indoor unit comes with a dry helium charge. 7. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 - 105%. 8. Must follow installation instructions in the applicable LG installation manual.

Intertek

8. Must follow installation instructions in the applicable LG installation manual.





Performance:

Nominal Cooling Capacity (Btu/h)		9,000
Nominal Heating Capacity (Btu/h)		10,900
Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB	Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB	

Electrical:

Power Supply (V ¹ /Hz/Ø)	208-230/60/1
Rated Amps (A)	0.4

Piping:

Installed Liquid Pipe (in., O.D.)	ø1/4
Installed Vapor Pipe (in., O.D.)	ø3/8
Liquid Connection (in., O.D.)	ø1/4
Vapor Connection (in., O.D.)	ø3/8
Drain (in., O.D. / I.D.)	27/32 , 5/8
Temperature Sensor	Thermistor

Controls Features:

- 4-Way auto swing
 24-Hour on/off timer
 Auto operation
- Auto restart
 Chaos wind
- Self-cleaning indoor coil
 Sleep mode
 Condensate sensor connection
 Built-in Wi-Fi via Smart ThinQ app

Jet cool/Jet heat
3M Micro Dust Filter

 Inverter (variable speed fan) Compatible with Single Zone HSV5 Outdoor Units


Included Accessories:

Wireless Remote Controller — AKB74955602

Optional Accessories:

- □ MultiSITE™ CRC1 PREMTBVC0 □ MultiSITE CRC1+ PREMTBVC1 □ Dry Contact PDRYCB300

SB_MultiF_WallMount_HiEff_IDU_LSN090HSV5_2022_11_09_122831 Consider the second sec

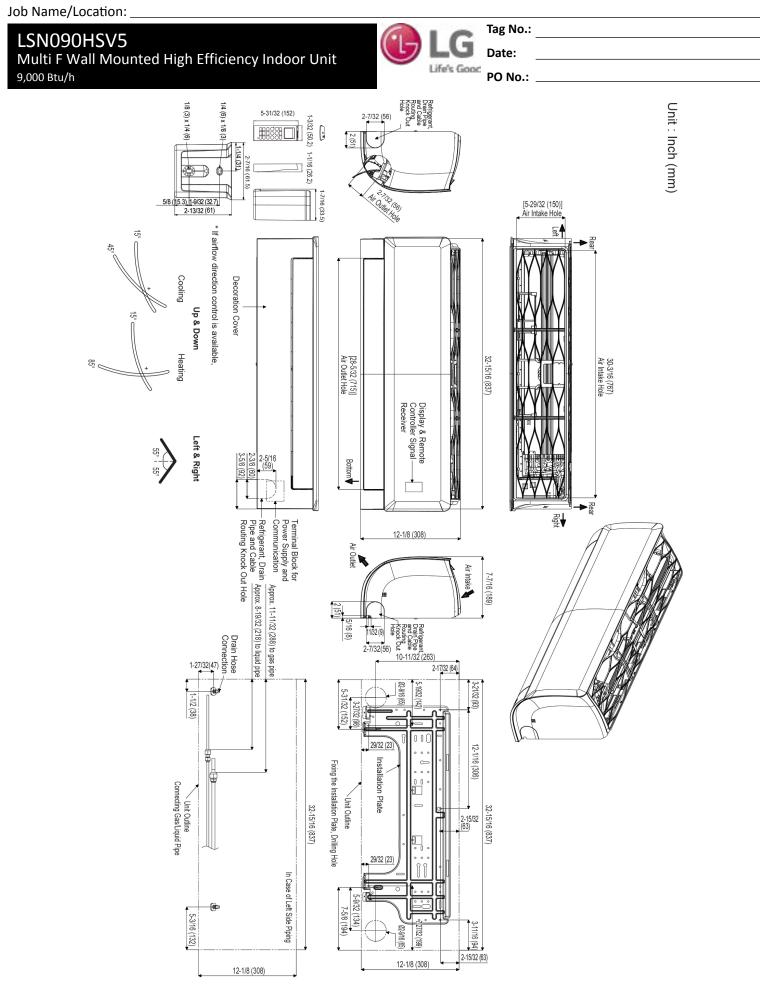

For continual product development, LG reserves the right to change specifications without notice. SB_MultiF_\ © LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com SB_MultiF_WallMount_HiEff_IDU_LSN090HSV5_2022_11_09_122831

Page 2 of 2

Job	Name/	Location:
-----	-------	-----------

|--|

T	a	g

#:

альны. 	
Ŕ	
	BATWO R

(Company)

LSN120HSV5 Multi F Wall Mounted High Efficiency Indoor Unit 12,000 Btu/h



Entering Mixed Air:

Cooling (°F WB)	57 ~ 77
Heating (°F DB)	59 ~ 81

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (H/M/L) (±3 dB[A]) ²	38 / 34 / 29
Primary Filter	Washable Pre-filter
Secondary Filter	3M Micro Dust
Net Weight (lbs.)	18.3
Shipping Weight (lbs.)	23.4

Fan:

Туре	Cross Flow
Type Quantity	1
Motor/Drive	Brushless Digitally Controlled/Direct
Air Flow H/M/L (CFM)	282 / 233 / 177

Notes:

INOTES: 1. Acceptable operating voltage: 187V-253V. 2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745. 3. See Engineering Manual for sensible and latent capacities. 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes. 5. Power wiring cable size must comply with the applicable local and national code. 6. The indoor unit comes with a dry helium charge. 7. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 - 105%. 8. Must follow installation instructions in the applicable LG installation manual.

8. Must follow installation instructions in the applicable LG installation manual.







Performance.

renormance.		
Nominal Cooling Capacity (Btu/h) Nominal Heating Capacity (Btu/h)		12,000 13,600
Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB	Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB	

Electrical:

Power Supply (V/Hz/Ø)	208-230/60/1
Rated Amps (A)	0.4

Piping:

Installed Liquid Pipe (in., O.D.)	ø1/4
Installed Vapor Pipe (in., O.D.)	ø3/8
Liquid Connection (in., O.D.)	ø1/4
Vapor Connection (in., O.D.)	ø3/8
Drain (in., O.D. / I.D.)	27/32 , 5/8
Temperature Sensor	Thermistor

Controls Features:

- 4-Way auto swing
 24-Hour on/off timer
 Auto operation
- Auto restart
 Chaos wind

Jet cool/Jet heat
3M Micro Dust Filter

- Self-cleaning indoor coil
 Sleep mode
 Condensate sensor connection
 Built-in Wi-Fi via Smart ThinQ app
- Inverter (variable speed fan) • Compatible with Single Zone HSV5 Outdoor Units


Included Accessories:

Wireless Remote Controller — AKB74955602

Optional Accessories:

- □ MultiSITE™ CRC1 PREMTBVC0 □ MultiSITE CRC1+ PREMTBVC1 □ Dry Contact PDRYCB300

Consider the second sec

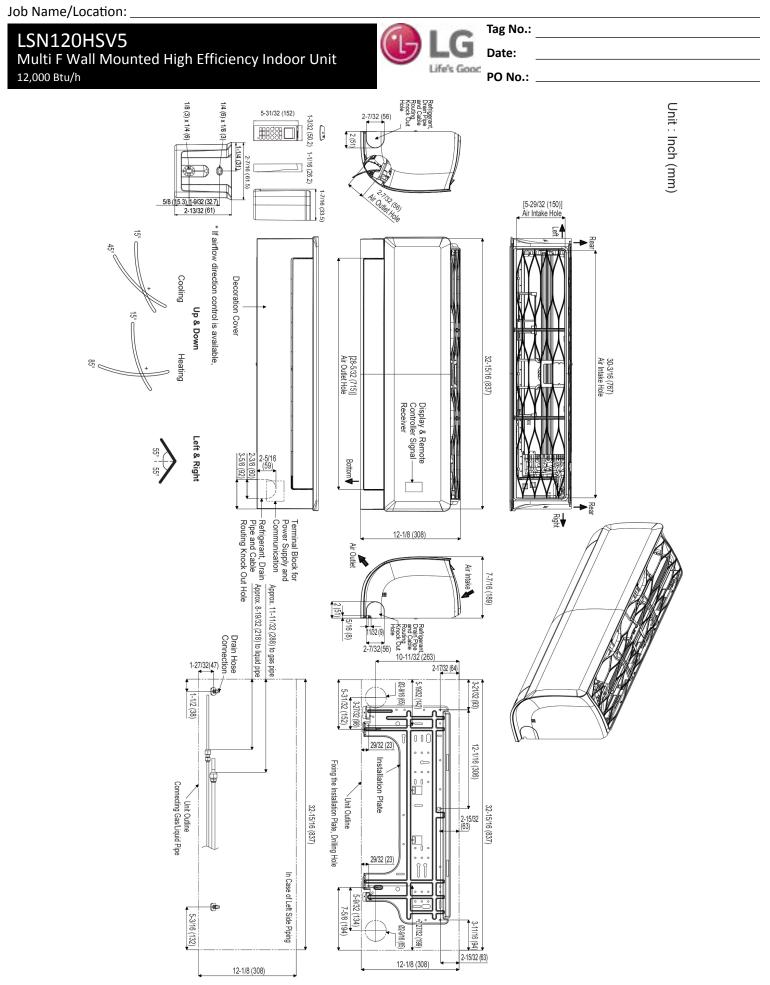

For continual product development, LG reserves the right to change specifications without notice. SB_MultiF_\ © LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com SB_MultiF_WallMount_HiEff_IDU_LSN120HSV5_2022_11_09_122830