Job Name/Location: Tag No:

For: File Resubmit Date: Approval Other PO No.:

Architect: GC: Mech: Engr:

Rep:

(Project Manager)

LMU303HV

Multi F Inverter Heat Pump Outdoor Unit

Performance:

Cooling Capacity (MinRated-Max., Btu/h)	8,400~30,000~36,000
Heating Capacity (MinRated-Max., Btu/h)	10,080~32,000~38,400
Max. Heating Capacity at 5°F (Btu/h)	24,000
Max. Heating Capacity at 0°F (Btu/h)	22,000
Max. Heating Capacity at -4°F (Btu/h)	20,400
EER2	13.0
SEER2	22.0
COP	4.0
HSPF2	9.2

Cooling Nominal Test Conditions: Heating Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Indoor: 70°F DB / 60°F WB Outdoor: 95°F DB / 75°F WB Outdoor: 47°F DB / 43°F WB

Electrical:

Power Supply (V/Hz/Ø)¹	208-230V, 60, 1
MOP (A)	25
MCA (A)	18.4
Recommended Fuse Size (A)	25
Cooling Rated Amps (A)	15.03
Heating Rated Amps (A)	15.03
Compressor (A)	13.5
Fan Motor (A)	0.73
Locked Rotor Amps (A)	19.0

MOP - Maximum Overcurrent Protection

MCA - Minimum Circuit Ampacity

Piping:

Refrigerant Charge (lbs.)	6.17
Liquid Line Connection (in., O.D.)	1/4 x 4
Vapor Line Connection (in., O.D.)	3/8 x 4
Maximum Total Piping ² (ft.)	246.1
Min. / Max. ODU to IDU Piping (ft.)	9.8 / 82.0
Piping Length (no add'l refrigerant, ft.)	98.4
Maximum Elevation between ODU and IDU (ft.)	49.2
Maximum Elevation between IDU and IDU (ft.)	24.6

ODU = Outdoor Unit IDU = Indoor Unit

Features:

- Auto operation
- Auto restart
- Inverter (variable speed compressor)
- Defrost / Deicing
- Restart delay (three [3] minutes)
- Self diagnosis
- Soft start
- Low ambient cooling down to 14°F



Operating Range:

Cooling (°F DB)	14 to 118
Heating (°F WB)	-4 to +64

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (Cool / Heat) ±1 dB(A) ³	51 / 54
Net / Shipping Weight (lbs.)	138.9 / 154.3
Heat Exchanger Coating	Gold Fin™
Minimum No. of Indoor Units	2
Maximum No. of Indoor Units	4

Compressor:

Туре		Twin Rotary
Quai	ntity	1
Oil /	Туре	FVC68D

Fan:

Type Quantity	Propeller
Quantity	1
Motor / Drive	Brushless Digitally Controlled/Direct
Max. Airflow Rate (CFM)	2.119

Notes:

- 1. Acceptable operating voltage: 187V 253V.
- 2. Piping lengths are equivalent.
- 3. Sound pressure levels are tested in an anechoic chamber under ISO Standard
- 4. All power / communication cable to be minimum 14 AWG, 4-conductor, stranded, shielded or unshielded wire, and must comply with applicable local and national codes. If shielded, the wire must be grounded to the chassis at the outdoor unit only.
- 5. Power wiring size must comply with the applicable local and national codes.
- 6. This data is rated 0 ft. above sea level, with 0 ft. level difference between outdoor and indoor units, and the following refrigerant pipe lengths:

LMU183HV: 16.4 ft. x 2 = 32.8 ft. LMU243HV: 16.4 ft. x 3 = 49.2 ft.

LMU303HV: 16.4 ft. x 4 = 65.6 ft.

LMU363HV: 16.4 ft. x 4 = 65.6 ft.

- All capacities are net with a combination ratio between 95 105%.
- 7. Must follow installation instructions in the applicable LG installation manual. 8. Refer to the Combintion Data Manual for combination capacity tables.
- 9. See the Performance Data Manual for sensible and latent capacities.



☐ PI-485 - PMNFP14A1 ☐ MultiSITE Comm. Mgr. -PBACNBTR0A

☐ AC Smart 5 - PACS5A000

☐ ACP 5 - PACP5A000

☐ Power Distribution Indicator (PDI)

Premium - PQNUD1S41

☐ Mobile LGMV - PLGMVW100 ☐ Drain Pan Heater - PQSH1200 □Low Ambient Baffle Kit (Cooling operation to -4°F) - ZLABGP04A











LMU303HV Multi F Inverter Heat Pump Outdoor Unit




		26(1-1/32)		· rvi	28(1-1/8)
397(16–21/32)	390(13)		⋄		
f				ריין	65(6–1/2)

[Unit : mm(inch)]

Gravity point

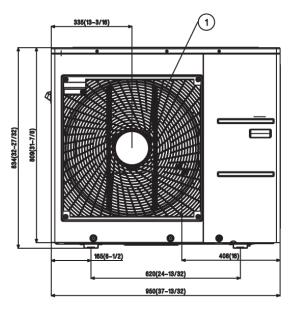

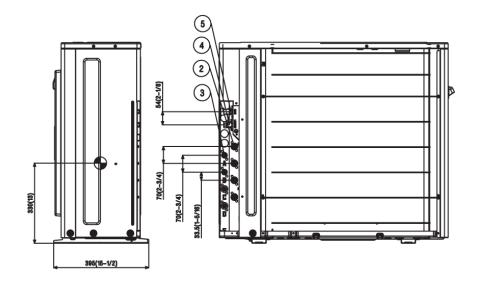

No.	Part Name
1	Air discharge grille
2	Vapor pipe connection
3	Liquid pipe connection
4	Main service valve (Liquid)
5	Main service valve (Vapor)

- 1. Unit must be installed in compliance with the installation manual.
- 2. Unit must be grounded in accordance with the local or state regulations and applicable national codes.
- 3. All field-supplied electrical components and materials must comply with local, state, and national codes.
- 4. Electrical characteristics must be considered for electrical work and design. The capacity of power cable and circuit breaker for the outdoor unit must follow local, state, national, and manufacturer requirements.

Job Name/Location:					Tag #:		
Date:	F	or:	File	Resubmit			
PO No.:			Approval	Other			
Architect:	GC:				_	фия	ELOLOW
Engr:	Mech:				-		
Rep:	(Project Mana	ger)			_		

Multi F Wall Mounted High Efficiency Indoor Unit 7,000 Btu/h



Performance:

Nominal Cooling Capacity (Btu/h)	7,000
Nominal Heating Capacity (Btu/h)	8,100

Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

Electrical:

Power Supply (V ¹ /Hz/Ø)	208-230/60/1
Rated Amps (A)	0.4

Piping:

Installed Liquid Pipe (in., O.D.)	ø1/4
Installed Vapor Pipe (in., O.D.)	ø3/8
Liquid Connection (in., O.D.)	ø1/4
Vapor Connection (in., O.D.)	ø3/8
Drain (in., O.D. / I.D.)	27/32,5/8
Temperature Sensor	Thermistor

Controls Features:

- 4-Way auto swing24-Hour on/off timerAuto operation

- Auto restartChaos wind
- Inverter (variable speed fan)
- Jet cool/Jet heat3M Micro Dust Filter

- Self-cleaning indoor coil
 Sleep mode
 Condensate sensor connection
 Built-in Wi-Fi via Smart ThinQ app

Included Accessories:

Wireless Remote Controller — AKB74955602

Optional Accessories:

☐ MultiSITE™ CRC1 - PREMTBVC0 ☐ MultiSITE CRC1+ - PREMTBVC1 ☐ Dry Contact - PDRYCB300

Entering Mixed Air:

Cooling (°F DB)	57 ~ 7 7
Heating (°F WB)	59 ~ 81

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (H/M/L) (±3 dB[A]) ²	35 / 31 / 26
Primary Filter	Washable Pre-filter
Secondard Filter	3M Micro Dust
Net Weight (lbs.)	18.3
Shipping Weight (lbs.)	23.4

Fan:

Туре	Cross Flow
Quantity	1
Motor/Drive	Brushless Digitally Controlled/Direct
Air Flow H/M/L (CFM)	254 / 204 / 148

- NOTES:

 1. Acceptable operating voltage: 187V-253V.
 2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
 3. See Engineering Manual for sensible and latent capacities.
 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
 5. Power wiring cable size must comply with applicable local and national code.
 6. The indoor unit comes with a dry helium charge.
 7. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 105%.
 8. Must follow installation in instructions in the applicable LG installation manual.

- 8. Must follow installation instructions in the applicable LG installation manual.








Job I	Name/	Location:
-------	-------	-----------

Multi F Wall Mounted High Efficiency Indoor Unit 7,000 Btu/h



Tag No.: ______

Date: _____
PO No.: _____

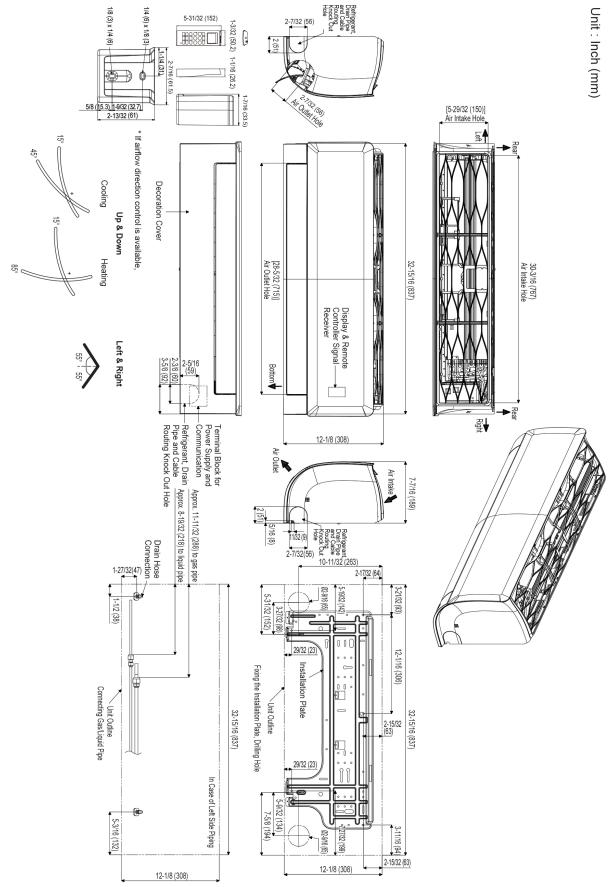

Job Name/Location:					Tag #:		
Date:	F	or:	File	Resubmit			
PO No.:			Approval	Other			
Architect:	GC:				_	фия	ELOLOW
Engr:	Mech:				-		
Rep:	(Project Mana	ger)			_		

Multi F Wall Mounted High Efficiency Indoor Unit 7,000 Btu/h



Performance:

Nominal Cooling Capacity (Btu/h)	7,000
Nominal Heating Capacity (Btu/h)	8,100

Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

Electrical:

Power Supply (V ¹ /Hz/Ø)	208-230/60/1
Rated Amps (A)	0.4

Piping:

Installed Liquid Pipe (in., O.D.)	ø1/4
Installed Vapor Pipe (in., O.D.)	ø3/8
Liquid Connection (in., O.D.)	ø1/4
Vapor Connection (in., O.D.)	ø3/8
Drain (in., O.D. / I.D.)	27/32,5/8
Temperature Sensor	Thermistor

Controls Features:

- 4-Way auto swing24-Hour on/off timerAuto operation

- Auto restartChaos wind
- Inverter (variable speed fan)
- Jet cool/Jet heat3M Micro Dust Filter

- Self-cleaning indoor coil
 Sleep mode
 Condensate sensor connection
 Built-in Wi-Fi via Smart ThinQ app

Included Accessories:

Wireless Remote Controller — AKB74955602

Optional Accessories:

☐ MultiSITE™ CRC1 - PREMTBVC0 ☐ MultiSITE CRC1+ - PREMTBVC1 ☐ Dry Contact - PDRYCB300

Entering Mixed Air:

Cooling (°F DB)	57 ~ 7 7
Heating (°F WB)	59 ~ 81

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (H/M/L) (±3 dB[A]) ²	35 / 31 / 26
Primary Filter	Washable Pre-filter
Secondard Filter	3M Micro Dust
Net Weight (lbs.)	18.3
Shipping Weight (lbs.)	23.4

Fan:

Туре	Cross Flow
Quantity	1
Motor/Drive	Brushless Digitally Controlled/Direct
Air Flow H/M/L (CFM)	254 / 204 / 148

- NOTES:

 1. Acceptable operating voltage: 187V-253V.
 2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
 3. See Engineering Manual for sensible and latent capacities.
 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
 5. Power wiring cable size must comply with applicable local and national code.
 6. The indoor unit comes with a dry helium charge.
 7. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 105%.
 8. Must follow installation in instructions in the applicable LG installation manual.

- 8. Must follow installation instructions in the applicable LG installation manual.








Job I	Name/	Location:
-------	-------	-----------

Multi F Wall Mounted High Efficiency Indoor Unit 7,000 Btu/h



Tag No.: ______

Date: _____
PO No.: _____

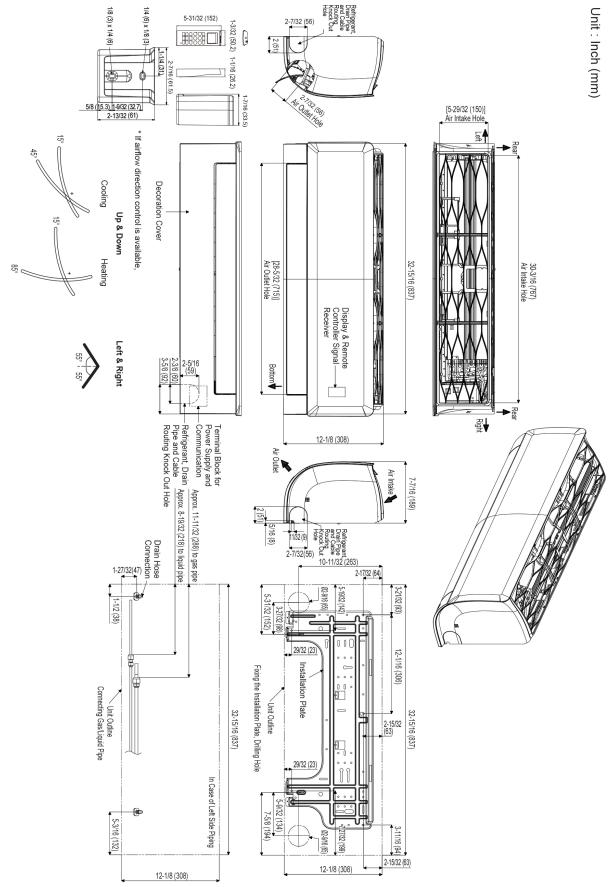

Job Name/Location: Tag #: For: File Resubmit Date: Approval Other. PO No .: GC: Architect: Mech: Engr: Rep: (Project Manager) (Company)

LSN090HSV5

Multi F Wall Mounted High Efficiency Indoor Unit 9,000 Btu/h



Performance:

Nominal Cooling Capacity (Btu/h)	9,000
Nominal Heating Capacity (Btu/h)	10,900

Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

Electrical:

Power Supply (V ¹ /Hz/Ø)	208-230/60/1
Rated Amps (A)	0.4

Piping:

Installed Liquid Pipe (in., O.D.)	ø1/4
Installed Vapor Pipe (in., O.D.)	ø3/8
Liquid Connection (in., O.D.)	ø1/4
Vapor Connection (in., O.D.)	ø3/8
Drain (in., O.D. / I.D.)	27/32,5/8
Temperature Sensor	Thermistor

Controls Features:

- 4-Way auto swing24-Hour on/off timer
- Auto operation

- Auto restartChaos wind
- Inverter (variable speed fan)
- Jet cool/Jet heat3M Micro Dust Filter

- Self-cleaning indoor coil
 Sleep mode
 Condensate sensor connection
 Built-in Wi-Fi via Smart ThinQ app
- Compatible with Single Zone HSV5 Outdoor Units

Included Accessories:

Wireless Remote Controller — AKB74955602

Optional Accessories:

☐ MultiSITE™ CRC1 - PREMTBVC0 ☐ MultiSITE CRC1+ - PREMTBVC1 ☐ Dry Contact - PDRYCB300

Entering Mixed Air:

Cooling (°F WB)	57 ~ 77
Heating (°F DB)	59 ~ 81

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (H/M/L) (±3 dB[A]) ²	36 / 32 / 27
Primary Filter	Washable Pre-filter
Secondary Filter	3M Micro Dust
Net Weight (lbs.)	18.3
Shipping Weight (lbs.)	23.4
'' " " '	

Fan:

Туре	Cross Flow
Quantity	1
Motor/Drive	Brushless Digitally Controlled/Direct
Air Flow H/M/L (CFM)	268 / 218 / 169

- NOTES:

 1. Acceptable operating voltage: 187V-253V.
 2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
 3. See Engineering Manual for sensible and latent capacities.
 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
 5. Power wiring cable size must comply with applicable local and national code.
 6. The indoor unit comes with a dry helium charge.
 7. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 105%.
 8. Must follow installation in instructions in the applicable LG installation manual.

- 8. Must follow installation instructions in the applicable LG installation manual.










LSN090HSV5

Multi F Wall Mounted High Efficiency Indoor Unit 9,000 Btu/h



Tag No.: ______
Date: _____

PO No.:

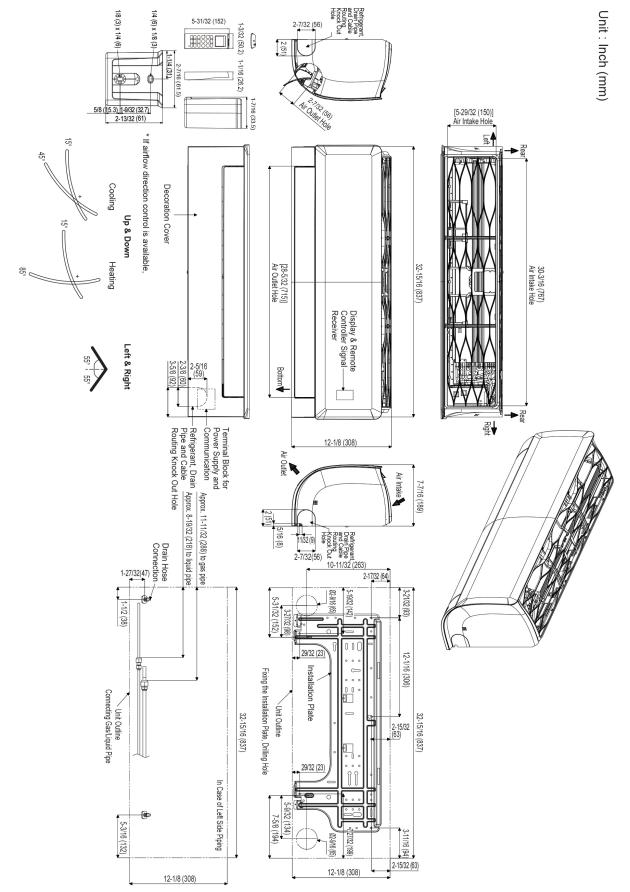

Job Name/Location: Tag #: For: File Resubmit Date: Approval Other. PO No .: GC: Architect: Mech: Engr: Rep: (Project Manager) (Company)

LSN090HSV5

Multi F Wall Mounted High Efficiency Indoor Unit 9,000 Btu/h



Performance:

Nominal Cooling Capacity (Btu/h)	9,000
Nominal Heating Capacity (Btu/h)	10,900

Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

Electrical:

Power Supply (V ¹ /Hz/Ø)	208-230/60/1
Rated Amps (A)	0.4

Piping:

Installed Liquid Pipe (in., O.D.)	ø1/4
Installed Vapor Pipe (in., O.D.)	ø3/8
Liquid Connection (in., O.D.)	ø1/4
Vapor Connection (in., O.D.)	ø3/8
Drain (in., O.D. / I.D.)	27/32,5/8
Temperature Sensor	Thermistor

Controls Features:

- 4-Way auto swing24-Hour on/off timer
- Auto operation

- Auto restartChaos wind
- Inverter (variable speed fan)
- Jet cool/Jet heat3M Micro Dust Filter

- Self-cleaning indoor coil
 Sleep mode
 Condensate sensor connection
 Built-in Wi-Fi via Smart ThinQ app
- Compatible with Single Zone HSV5 Outdoor Units

Included Accessories:

Wireless Remote Controller — AKB74955602

Optional Accessories:

☐ MultiSITE™ CRC1 - PREMTBVC0 ☐ MultiSITE CRC1+ - PREMTBVC1 ☐ Dry Contact - PDRYCB300

Entering Mixed Air:

Cooling (°F WB)	57 ~ 77
Heating (°F DB)	59 ~ 81

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (H/M/L) (±3 dB[A]) ²	36 / 32 / 27
Primary Filter	Washable Pre-filter
Secondary Filter	3M Micro Dust
Net Weight (lbs.)	18.3
Shipping Weight (lbs.)	23.4
'' " " '	

Fan:

Туре	Cross Flow
Quantity	1
Motor/Drive	Brushless Digitally Controlled/Direct
Air Flow H/M/L (CFM)	268 / 218 / 169

- NOTES:

 1. Acceptable operating voltage: 187V-253V.
 2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
 3. See Engineering Manual for sensible and latent capacities.
 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
 5. Power wiring cable size must comply with applicable local and national code.
 6. The indoor unit comes with a dry helium charge.
 7. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 105%.
 8. Must follow installation in instructions in the applicable LG installation manual.

- 8. Must follow installation instructions in the applicable LG installation manual.










LSN090HSV5

Multi F Wall Mounted High Efficiency Indoor Unit 9,000 Btu/h



Tag No.: ______
Date: _____

PO No.:

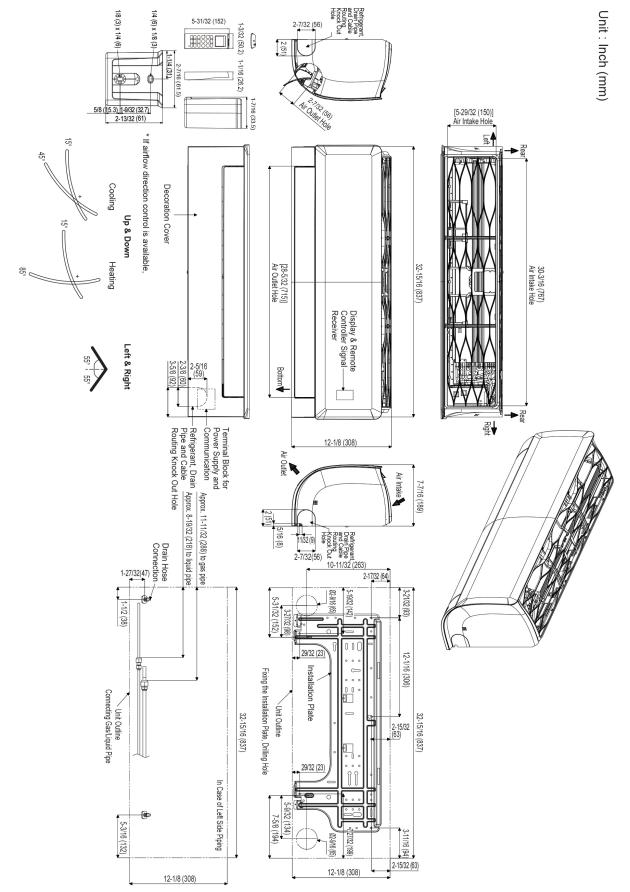

Job Name/Location: Tag #: For: File Resubmit Date: Approval Other. PO No .: GC: Architect: Mech: Engr: Rep: (Project Manager) (Company)

LSN120HSV5

Multi F Wall Mounted High Efficiency Indoor Unit 12,000 Btu/h



Performance:

Nominal Cooling Capacity (Btu/h)	12,000
Nominal Heating Capacity (Btu/h)	13,600

Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

Electrical:

Power Supply (V¹/Hz/Ø)	208-230/60/1
Rated Amps (A)	0.4

Piping:

Installed Liquid Pipe (in., O.D.)	ø1/4
Installed Vapor Pipe (in., O.D.)	ø3/8
Liquid Connection (in., O.D.)	ø1/4
Vapor Connection (in., O.D.)	ø3/8
Drain (in., O.D. / I.D.)	27/32,5/8
Temperature Sensor	Thermistor

Controls Features:

- 4-Way auto swing24-Hour on/off timer
- Auto operation
- Auto restartChaos wind

- Inverter (variable speed fan)
- Jet cool/Jet heat3M Micro Dust Filter

- Self-cleaning indoor coil
 Sleep mode
 Condensate sensor connection
 Built-in Wi-Fi via Smart ThinQ app
- Compatible with Single Zone HSV5 Outdoor Units

Included Accessories:

Wireless Remote Controller — AKB74955602

Optional Accessories:

☐ MultiSITE™ CRC1 - PREMTBVC0 ☐ MultiSITE CRC1+ - PREMTBVC1 ☐ Dry Contact - PDRYCB300

Entering Mixed Air:

Cooling (°F WB)	57 ~ 77
Heating (°F DB)	59 ~ 81

Unit Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Sound Pressure (H/M/L) (±3 dB[A]) ²	38 / 34 / 29
Primary Filter	Washable Pre-filter
Secondary Filter	3M Micro Dust
Net Weight (lbs.)	18.3
Shipping Weight (lbs.)	23.4

Fan:

Type Quantity	Cross Flow
Quantity	1
Motor/Drive	Brushless Digitally Controlled/Direct
Air Flow H/M/L (CFM)	282 / 233 / 177

- NOTES:

 1. Acceptable operating voltage: 187V-253V.
 2. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
 3. See Engineering Manual for sensible and latent capacities.
 4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 18 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
 5. Power wiring cable size must comply with applicable local and national code.
 6. The indoor unit comes with a dry helium charge.
 7. Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 105%.
 8. Must follow installation in instructions in the applicable LG installation manual.

- 8. Must follow installation instructions in the applicable LG installation manual.







LSN120HSV5

Multi F Wall Mounted High Efficiency Indoor Unit 12,000 Btu/h



Tag No.: ______

Date: _____

PO No.: _____

