Job Name	/Location:
----------	------------

PO No.:

Architect:

Engr:

Rep: (Company)

KNUAK091A

Performance:

Electrical:

Piping:

Cooling Nominal Test Conditions: Indoor: 80°F DB / 67°F WB Outdoor: 95°F DB / 75°F WB

Power Supply (V/Hz/Ø)^{1,2}

Installed Liquid Pipe (in., O.D.)

Installed Vapor Pipe (in., O.D.) Liquid Connection (in., O.D.)

Vapor Connection (in., O.D.)

Rated Current (A)

Nominal Cooling Capacity (Btu/h)

Nominal Heating Capacity (Btu/h)

R32 Multi F Art Cool™ Mirror Wall Mounted Indoor Unit 9,000 Btu/h



Entering Mixed Air:

Cooling (°F WB)	57 ~ 77
Heating (°F DB)	59 ~ 81

Unit Data:

Refrigerant Type	R32
Refrigerant Control	EEV
Sound Pressure (H/M/L) (±3 dB[A]) ³	36 / 32 / 27
Primary Filter	Washable Pre-filter
Secondary Filter	3M Micro Dust
Net Weight (lbs.)	22.7
Shipping Weight (lbs.)	24.5

Fan:

Type Quantity Motor/Drive Air Flow H/M/L (CFM)	Cross Flow 1 Brushless Digitally Controlled/Direct 268 / 218 / 169
Air Flow H/M/L (CFM) Dehumidification (pts./hr.)	268 / 218 / 169 2.70

Controls Features:

Drain (in., O.D. / I.D.)

Temperature Sensor

- Left / right and up / down auto swing
- 24-Hour on/off timer
- Auto operation
- Auto restart
- Group control
- Inverter (variable speed fan)
- Jet cool / Jet heat • 3M Micro Dust Filter

Included Accessories:

Wireless Remote Controller — AKB76044208

Optional Accessories:

- Auxiliary Heater Kit PRARS1
- □ Single-Port Shutoff Valve PRHPZ010A

Controller Options:

- □ MultiSITE[™] CRC* Controllers
- □ Simple Remote Controllers
- □ Standard III Remote Controllers
- □ Deluxe Remote Controller
- □ Remote Temperature Button Sensor
- Dry Contacts

- · Self-cleaning indoor coil
- Sleep mode

Heating Nominal Test Conditions: Indoor: 70°F DB / 60°F WB Outdoor: 47°F DB / 43°F WB

- R32 leak detection sensor
- Built-in Wi-Fi via Smart ThinQ app
- Compatible with applicable Single Zone Outdoor Units (see
- single zone literature for matching system details)

Notes:

1. Acceptable operating voltage: 187V-253V.

The power wiring and the communication wiring from the outdoor unit to the indoor unit, or from the branch distribution unit to the indoor unit is field supplied and must be stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only). All wiring must comply with applicable local and national codes.

a. Power Wiring and Communication Wiring from Outdoor Unit to Indoor Unit (No. x AWG) 3 x 14 / 2 x 18. b. Power Wiring and Communication Wiring from Branch Distribution Unit to Indoor Unit (No. x AWG) 3 x 14 / 2 x 18.

- Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
 See Engineering Manual for sensible and latent capacities.

 The indoor unit comes with a dry helium charge.
 Corresponding refrigerant piping length is in accordance with standard length of each outdoor unit and the level difference is 0 ft. All capacities are net with a combination ratio between 95 - 105%

7. Must follow installation instructions in the applicable LG installation manual





Resubmit

Other_

For:

GC:

Mech:

(Project Manager)

File

9,000

10,900

208-230/60/1

0.4

ø1/4

ø3/8

ø1/4


ø3/8

27/32,5/8

Thermistor

Approval



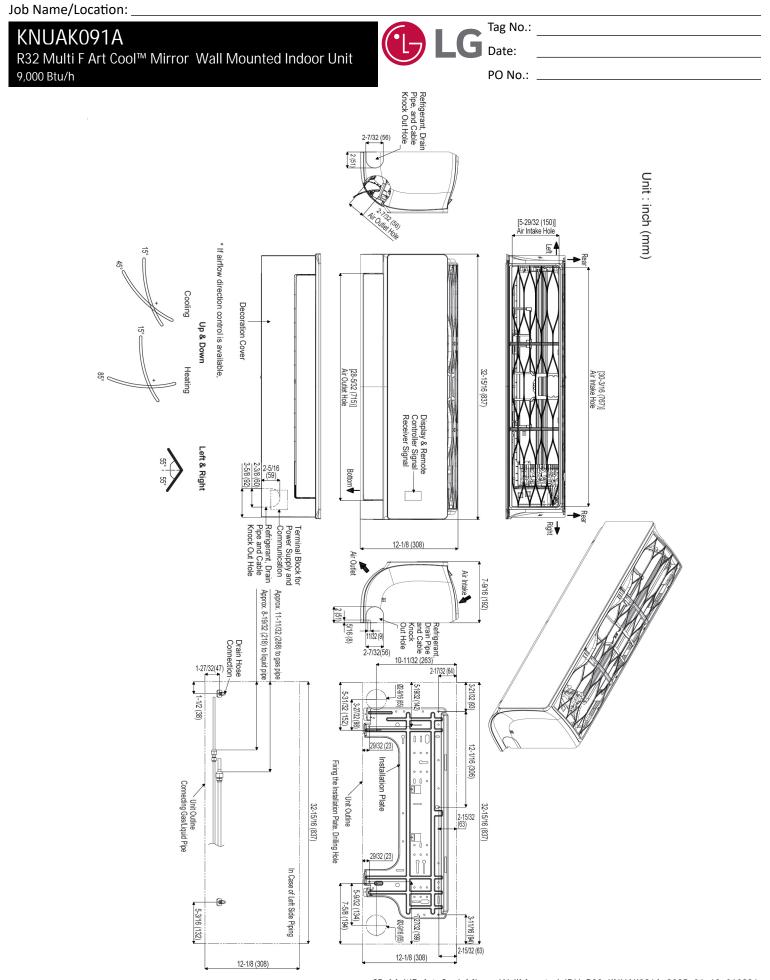

For continual product development, LG reserves the right to change specifications without notice. SB_MultiF_Art_Cool_Mirror_WallMounted_IDU_R32_KNUAK091A_2025_01_10_060926 @ LG Electronics U.S.A., Inc., Englewood Cliffs, NJ. All rights reserved. "LG Life's Good" is a registered trademark of LG Corp. /www.lghvac.com Page 2 of 2